





FLP-5177BPM

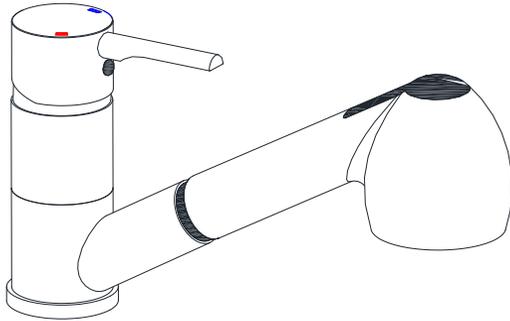

TECHNICAL DRAWING

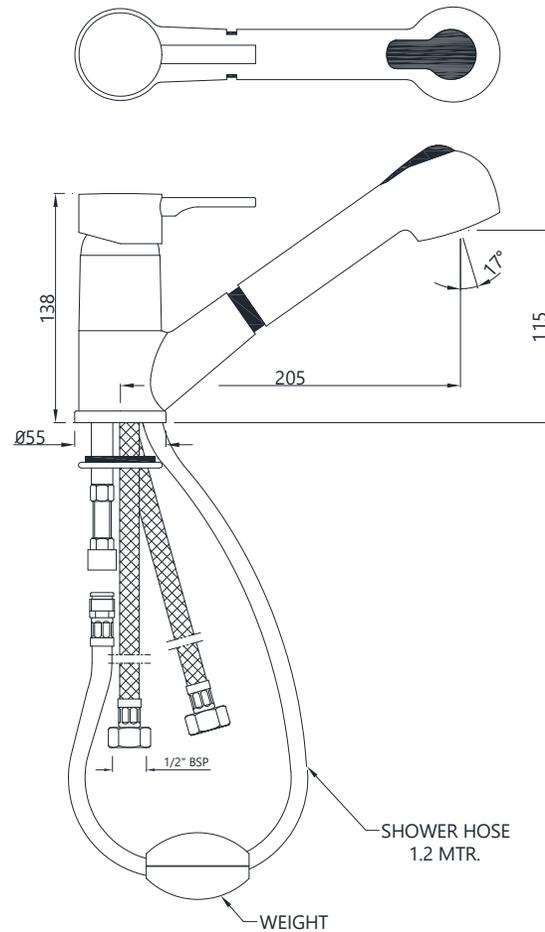



TEMP. & WATER PRESSURE REQUIREMENTS

	Working Pressure: 1~3 bar
	Required Temperature: 5-65°C






Note: Above values are the recommended values for Getting Conventional Outputs.

TAKE CARE DURING CONNECTION'S

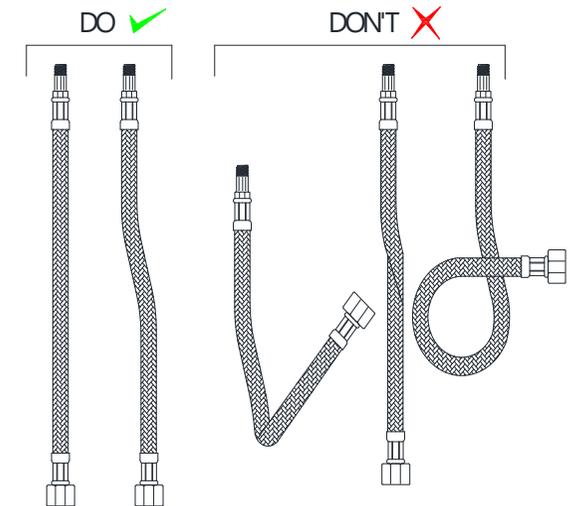

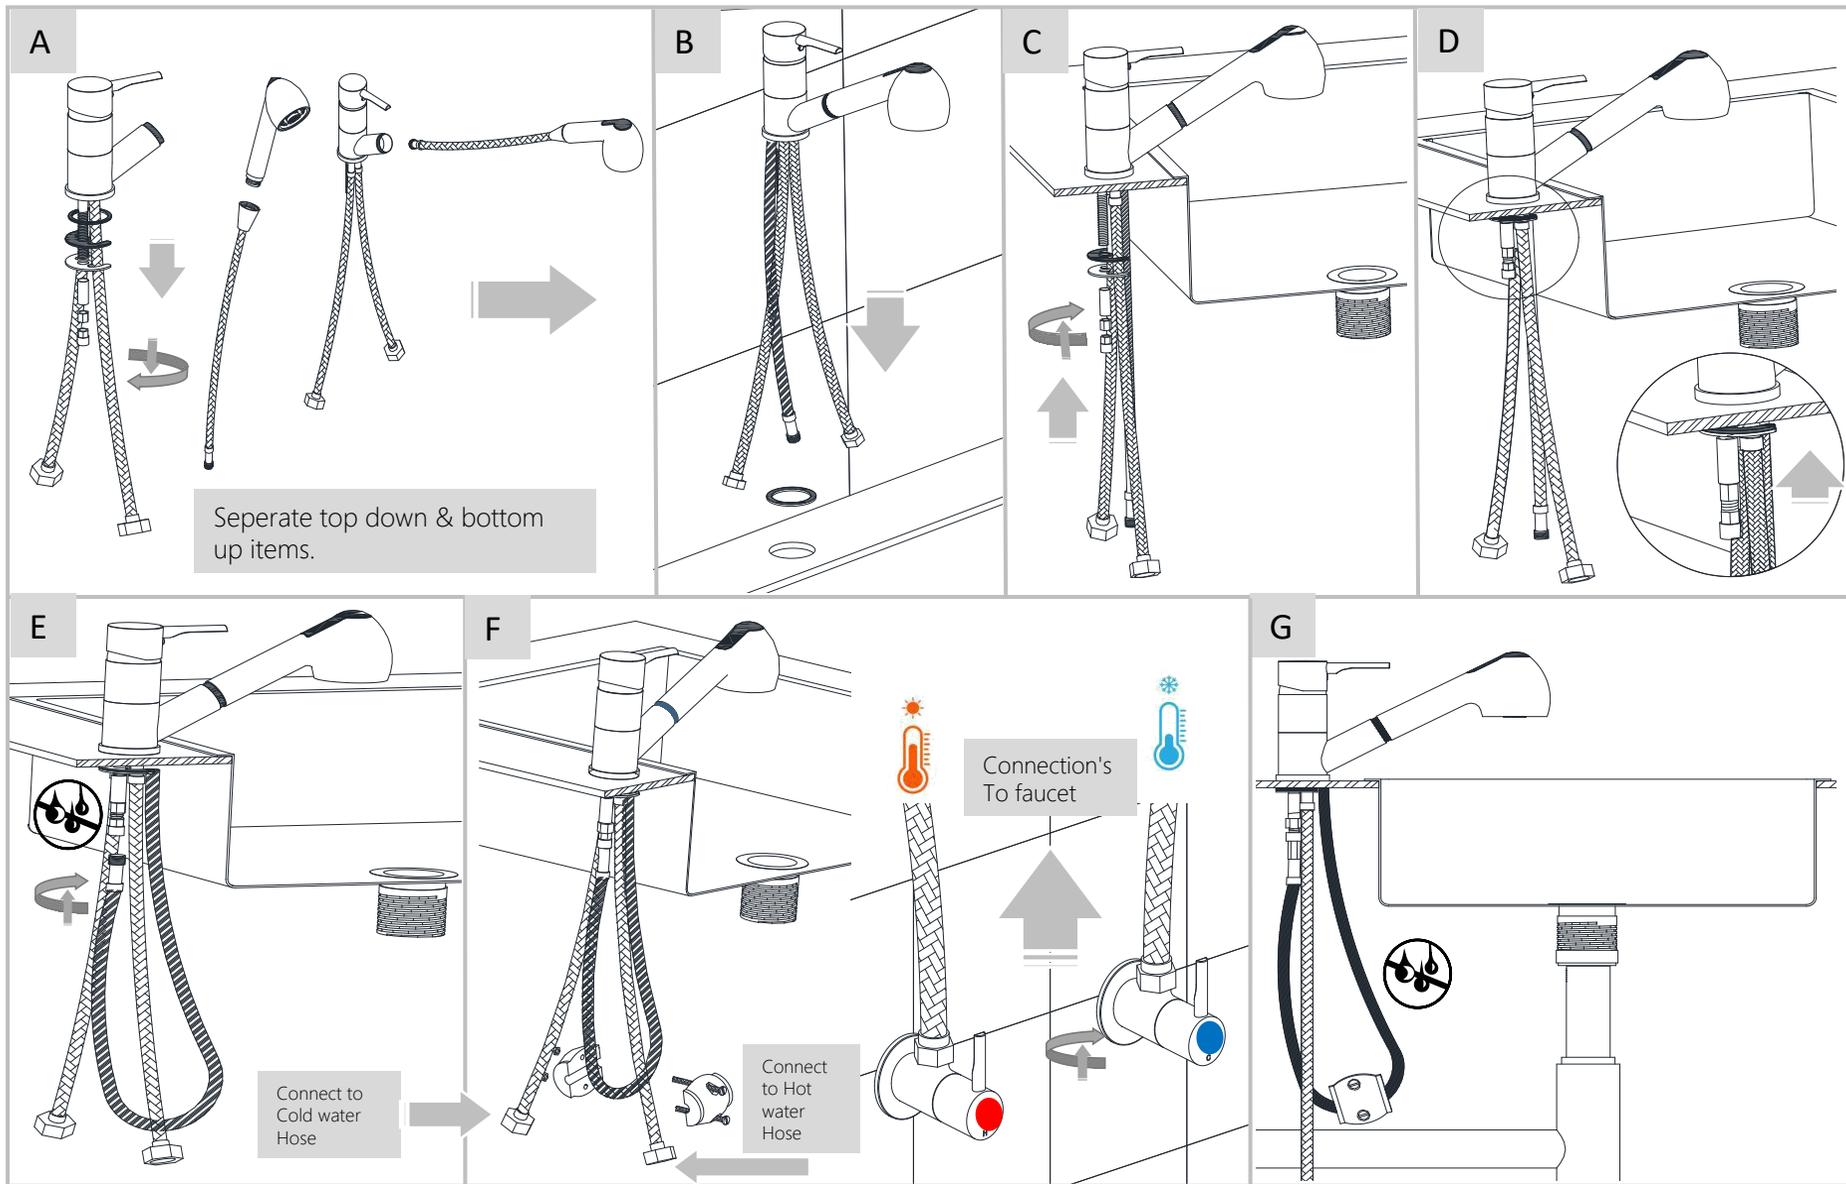

HOW TO OPERATE

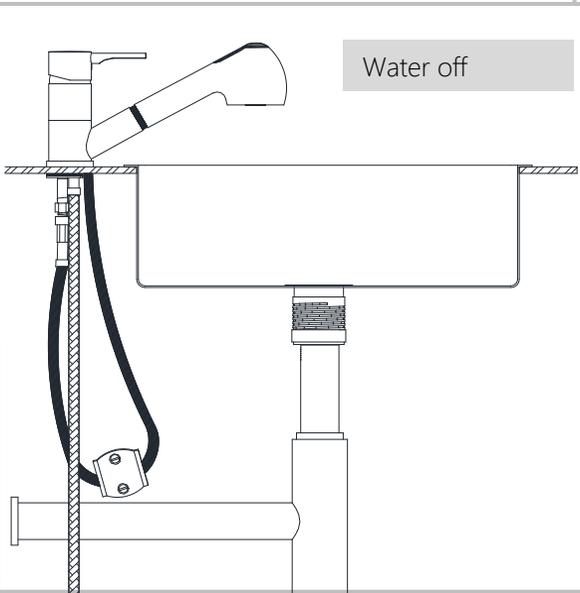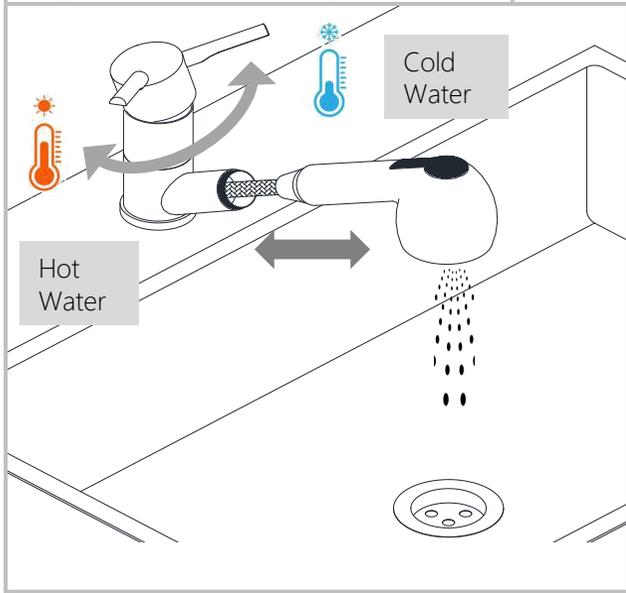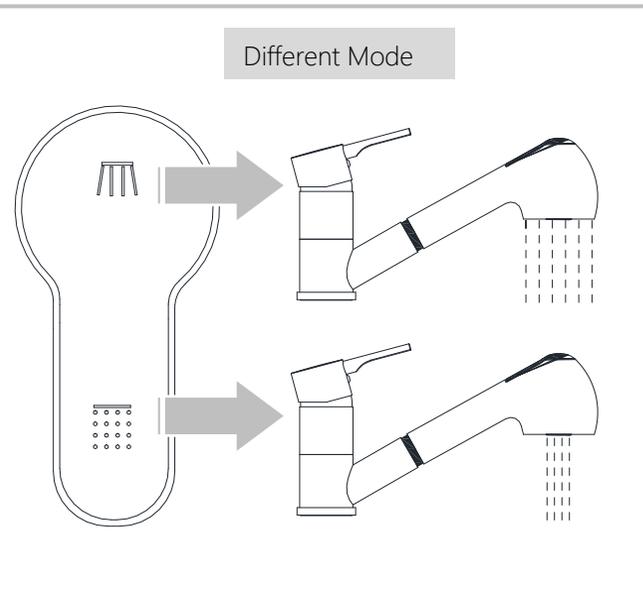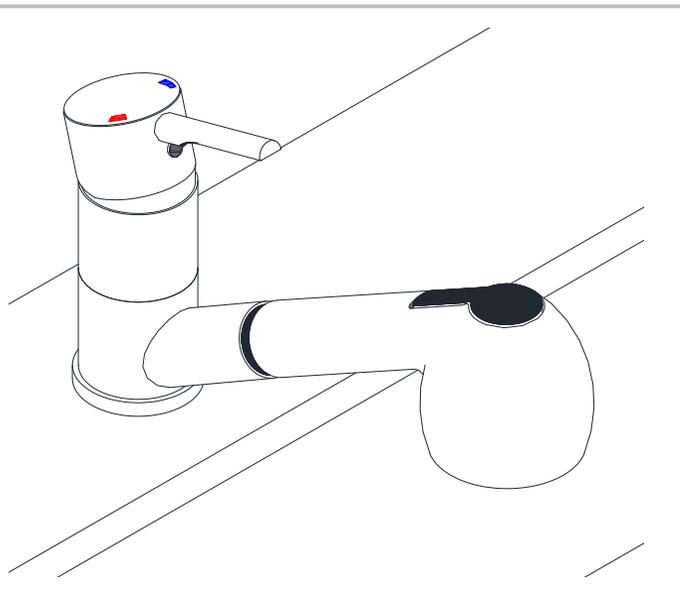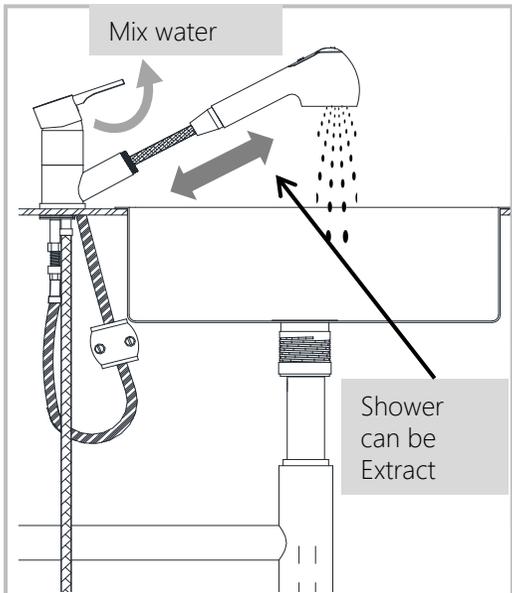



Apply soft cotton cloth



Apply soft cotton cloth



⊗ DON'T



⊗ DON'T

Don't apply Scrub

Steps & Cleaning agents requirements for Aerator Cleaning.

